




# WATER T&D Construction Standard

## STANDARD 1" SERVICE STUB INSTALLATION

APPLICATION: Typical residential subdivision service stub installation.  
For general reference and contract use.

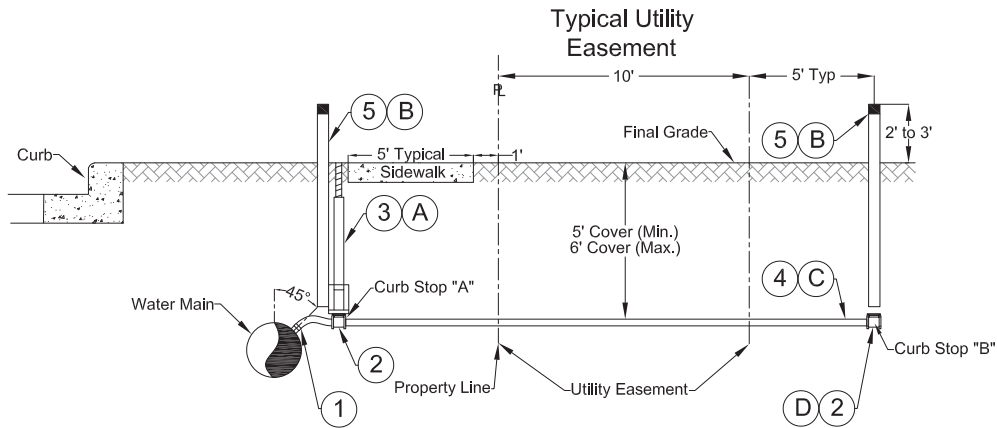

**INSTALLATION NOTES:**

- Typical service stub is 1" Dia. copper. Other sizes may be specified when required.
- Curb stops shall not be installed within the area designated for the driveway.
- Curb stop "A" shall be installed at a bury depth of 5'.
- Service is to extend 5' beyond the utility easement.
- If no utility easement exists, curb stop "B" shall not be installed. Corp. stop & curb stop "A" are all that will be required.
- Service stub installation shall include all documentation described in Water T&D Construction Standard W-03-0005.
- "Service Stubs" installed by non-BWL personnel shall be inspected by the BWL prior to backfill. Any services not visible shall be exposed for inspection prior to BWL approval. BWL shall charge a nominal fee per inspection. Refer to BWL "Rules and Regulations for Water Service" for current inspection fee.

- (A) After curb box is installed, raise curb box to final grade.
- (B) Install a 4"x4" wood post next to each curb stop with the top extending 2' to 3' above final grade. The top of the stake must be painted blue.
- (C) The copper stub between curb box "A" and curb box "B" must be pressurized to ensure that any damage to the stub will be recognized and repaired. Curb stop "A" will be left ON & curb stop "B" will be OFF until the service is extended.

MATERIALS FOR 1" SERVICE			
REF	ITEM NO.	QTY	DESCRIPTION
1	30-03446	1	CORP STOP, 1" CC X 1" CTS COMP
2	30-06166	2	CURB STOP, 1" CTS COMP BOTH ENDS
3	30-00320	1	CURB BOX, COMPLETE
4	30-45345	AS REQ'D	TUBE, COPPER TYPE K, 1" X 60FT
5	Non-Stock	2	4" X 4" WOOD POST

Manager, Water & Steam Distribution 8/18/2022  
DocuSigned by: Todd Russell  
EAD7A8CA6676D459 Date:

Director of Water Operations 8/19/2022  
DocuSigned by: Sanjeev Mungarwadi  
E1B176FA599F49A Date: