


Water T&D Construction Standard

3/4" SINGLE YOKE METER SETTING (METER TREE)

Application: Residential water service

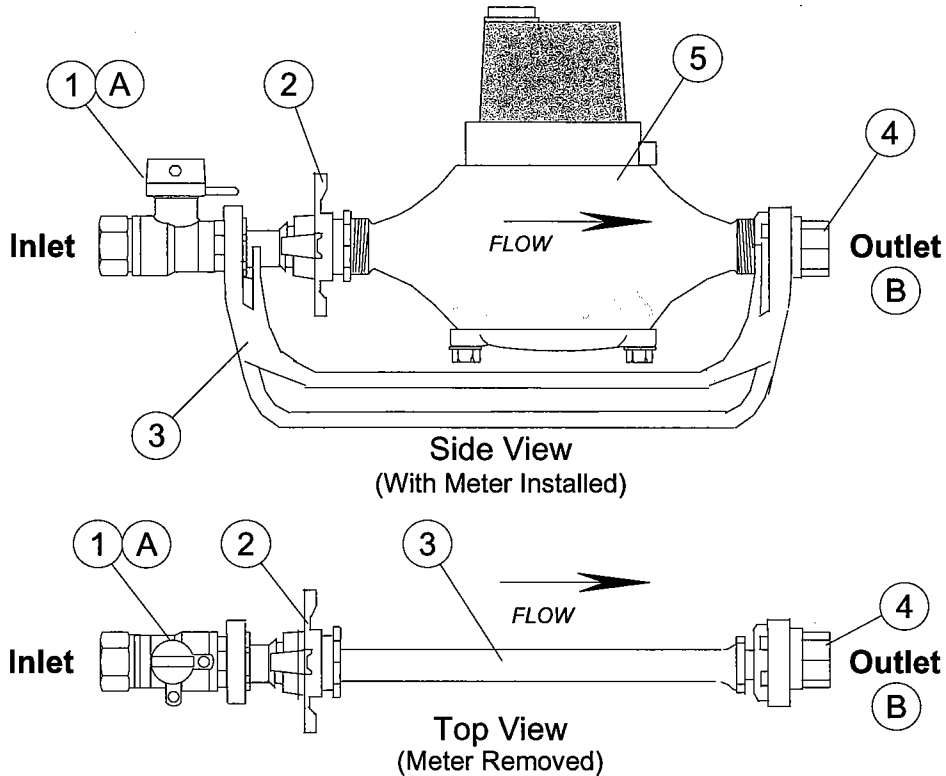

INSTALLATION NOTES

- Customers plumbing shall include a shut off valve on the outlet side of the meter setting or the water meter will not be installed by LBWL.

(A) Inlet valve shall be locked in the closed position if no meter is to be installed in the meter setting.

(B) Customer must have inlet valve installed and piping supported as required by Michigan plumbing code.

MATERIALS			
REF	ITEM NO.	QTY	DESCRIPTION
①	30-81408	1	Valve, Ball, Straight, 1" F.I.P. x 3/4" Yoke nut
②	30-23703	*1	Yoke Nut, Expansion, 3/4" Meter
③	30-30729	1	Yoke Frame, 3/4" Meter.
④	30-23761	1	Yoke, Connection, Outlet, straight. 3/4" Yoke nut x 3/4" F.I.P.
⑤	30-11437	*1	Meter, 3/4" Short Body,

* Installed by LBWL Meter Dept. when meter is placed into setting.

Director of Engineering Wood Date: 8/2/06
 Manager of Delivery Michael Green Date: 8/4/06